


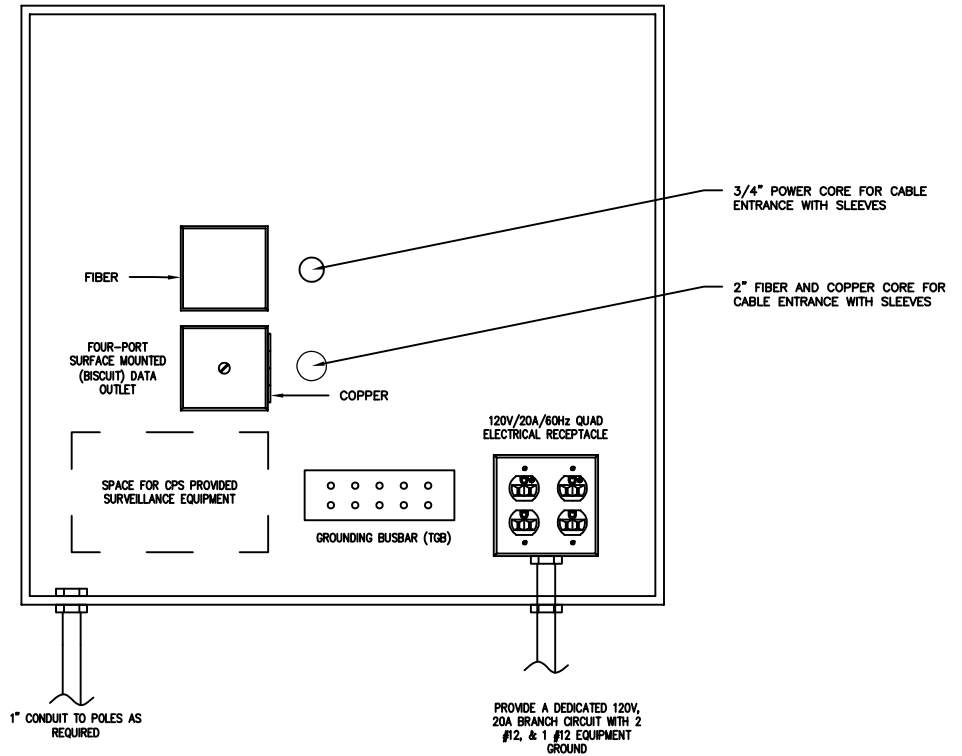

NOTES:

1. PROVIDE A 24"W x 24"L x12"D NEMA 4X RATED ENCLOSURE WITH LOCKING DOOR.
2. THE ENCLOSURE'S DOOR SHALL BE MONITORED BY DOOR POSITION SWITCH CONNECTED TO THE EXISTING HONEYWELL VISTA 50P INTRUSION DETECTION SYSTEM.
3. EACH COMPONENT SHALL BE MOUNTED WITH A MINIMUM OF 2" OF SPACE BETWEEN ADJACENT COMPONENTS OR THE ENCLOSURE WALL.
4. REFER TO SITE PLAN AND DETAILS FOR CABLE REQUIREMENTS AND ROUTING.
5. PROVIDE A 6AWG GROUNDING CABLE CONNECTION TO EQUIPMENT GROUND IN IT ENCLOSURE, POWER RECEPTACLE.
6. PROVIDE PLUGS TO ENSURE WATER DOES NOT SEEP INTO THE ENCLOSURE.

CHICAGO PUBLIC SCHOOLS
CAPITAL IMPROVEMENT PROGRAM
OFFICE OF SAFETY AND SECURITY
SECURITY STANDARDS

IT ENCLOSURE "NE-1"DETAIL
WIRELESS BRIDGE FOR CAMERA ONLY POLES



DESIGNED	CPS			
DRAWN	CPS			
CHECKED	CPS			
APPROVED	CPS			
NO.	DATE	REVISION	BY	

PROJECT:	PROJECT: ITS SYSTEM-DETAILS			SHEET NO.
PROJECT NUMBER	XXXX	SCALE	NONE	ED-240-R
DATE	06/19/20			