


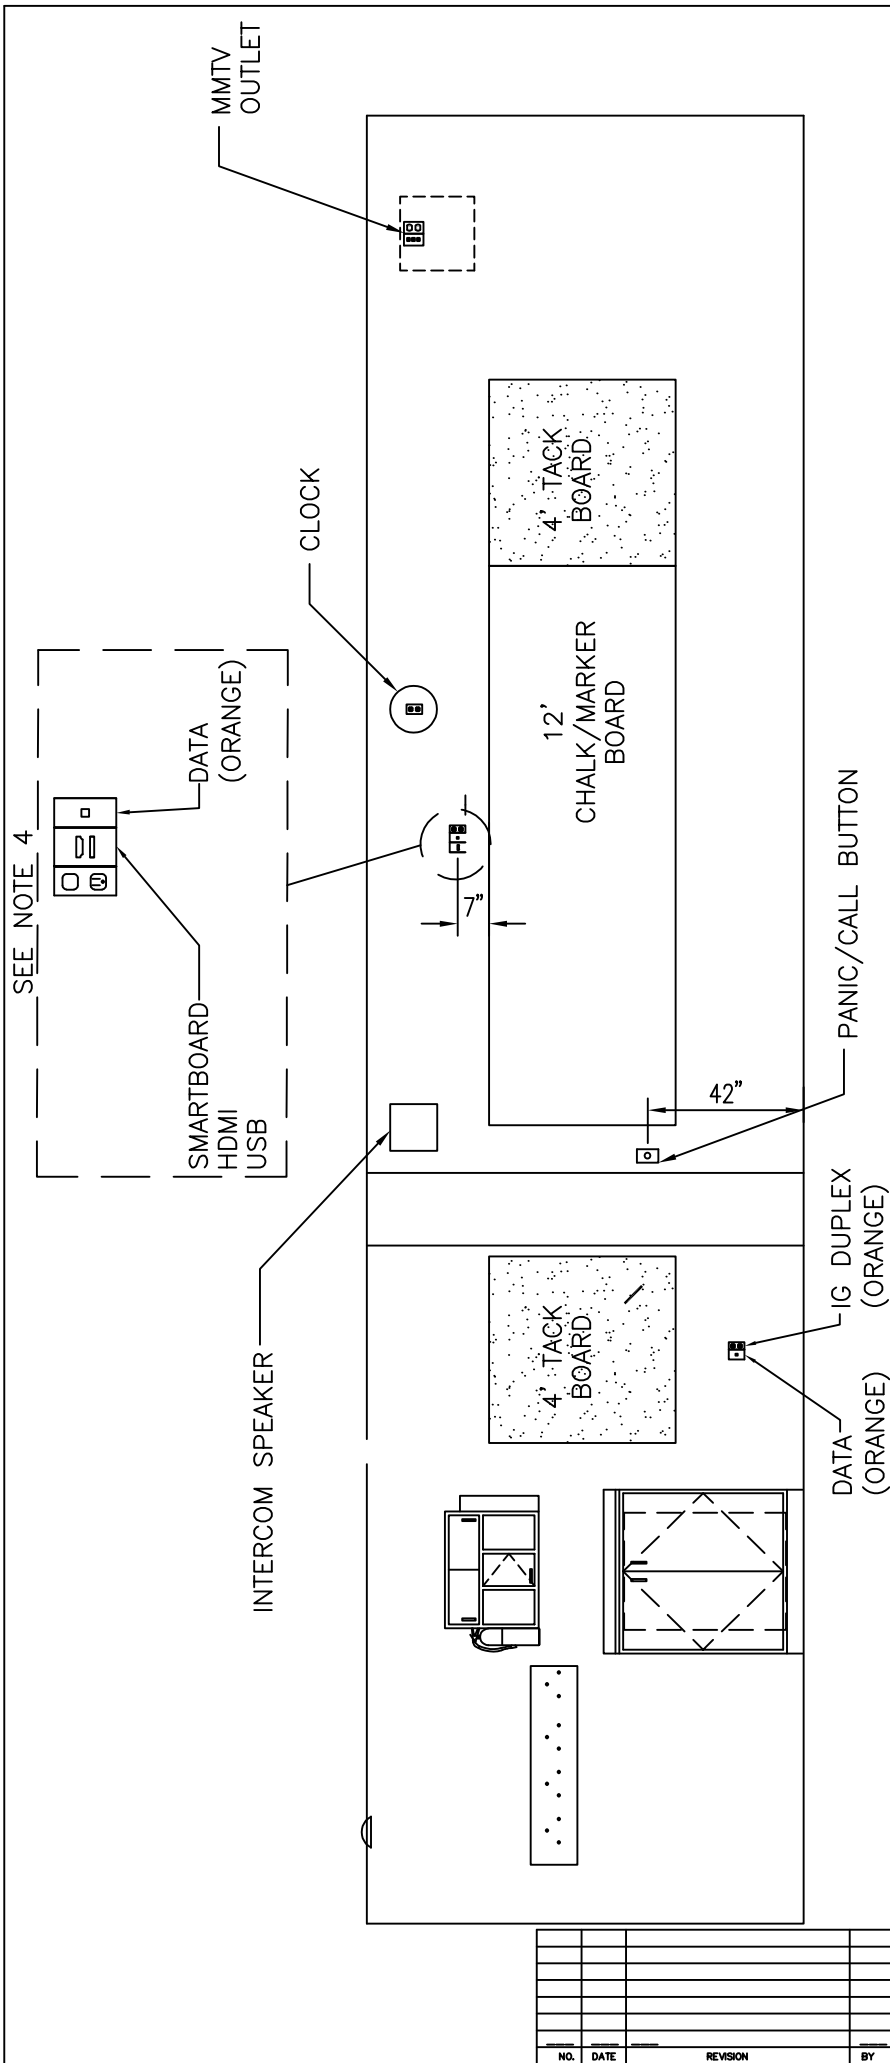

NOTES

FOR ALL WORKSTATION AND CLASSROOM COMPUTER STATION LOCATIONS SHOWN WITH A RECEPTACLE AND AN ASSOCIATED TELE/DATA DEVICE OR HDMI CONNECTION, PROVIDE A COMBINATION BACKBOX WITH A COMMON COVER. WALL BOX SHALL BE A TWO, THREE OR FOUR GANG BACKBOX WITH A DIVIDER, IN ORDER TO ACCOMMODATE THE POWER AND DATA. BACKBOX SHALL BE THE WALLSOURCE BACKBOX AS MANUFACTURED BY WIREMOLD OR EQUIVALENT. PROVIDE ALL NECESSARY ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION.

BACKBOXES SHALL BE OFFSET AND NOT MOUNTED BACK TO BACK.

HDMI AND USB CONNECTION TO TEACHING ISLAND.

REFER TO DETAIL ED.011A FOR HUBBELL PART NUMBERS FOR POWER RECEPTACLE, HDMI AND USB OUTLETS.

- 1.
- 2.
- 3.
- 4.

 CHICAGO PUBLIC SCHOOLS CAPITAL IMPROVEMENT PROGRAM INFORMATION TECHNOLOGY SERVICES INFRASTRUCTURE STANDARDS TYPICAL INTERIOR ELEVATION SCIENCE LAB – RENOVATION				SHEET NO.	
DESIGNED CPS	PROJECT NUMBER			ED.303B	
DRAWN CPS					
CHECKED CPS					
APPROVED CPS					
NO.	DATE	REVISION	BY	SCALE NONE	DATE 06/01/24