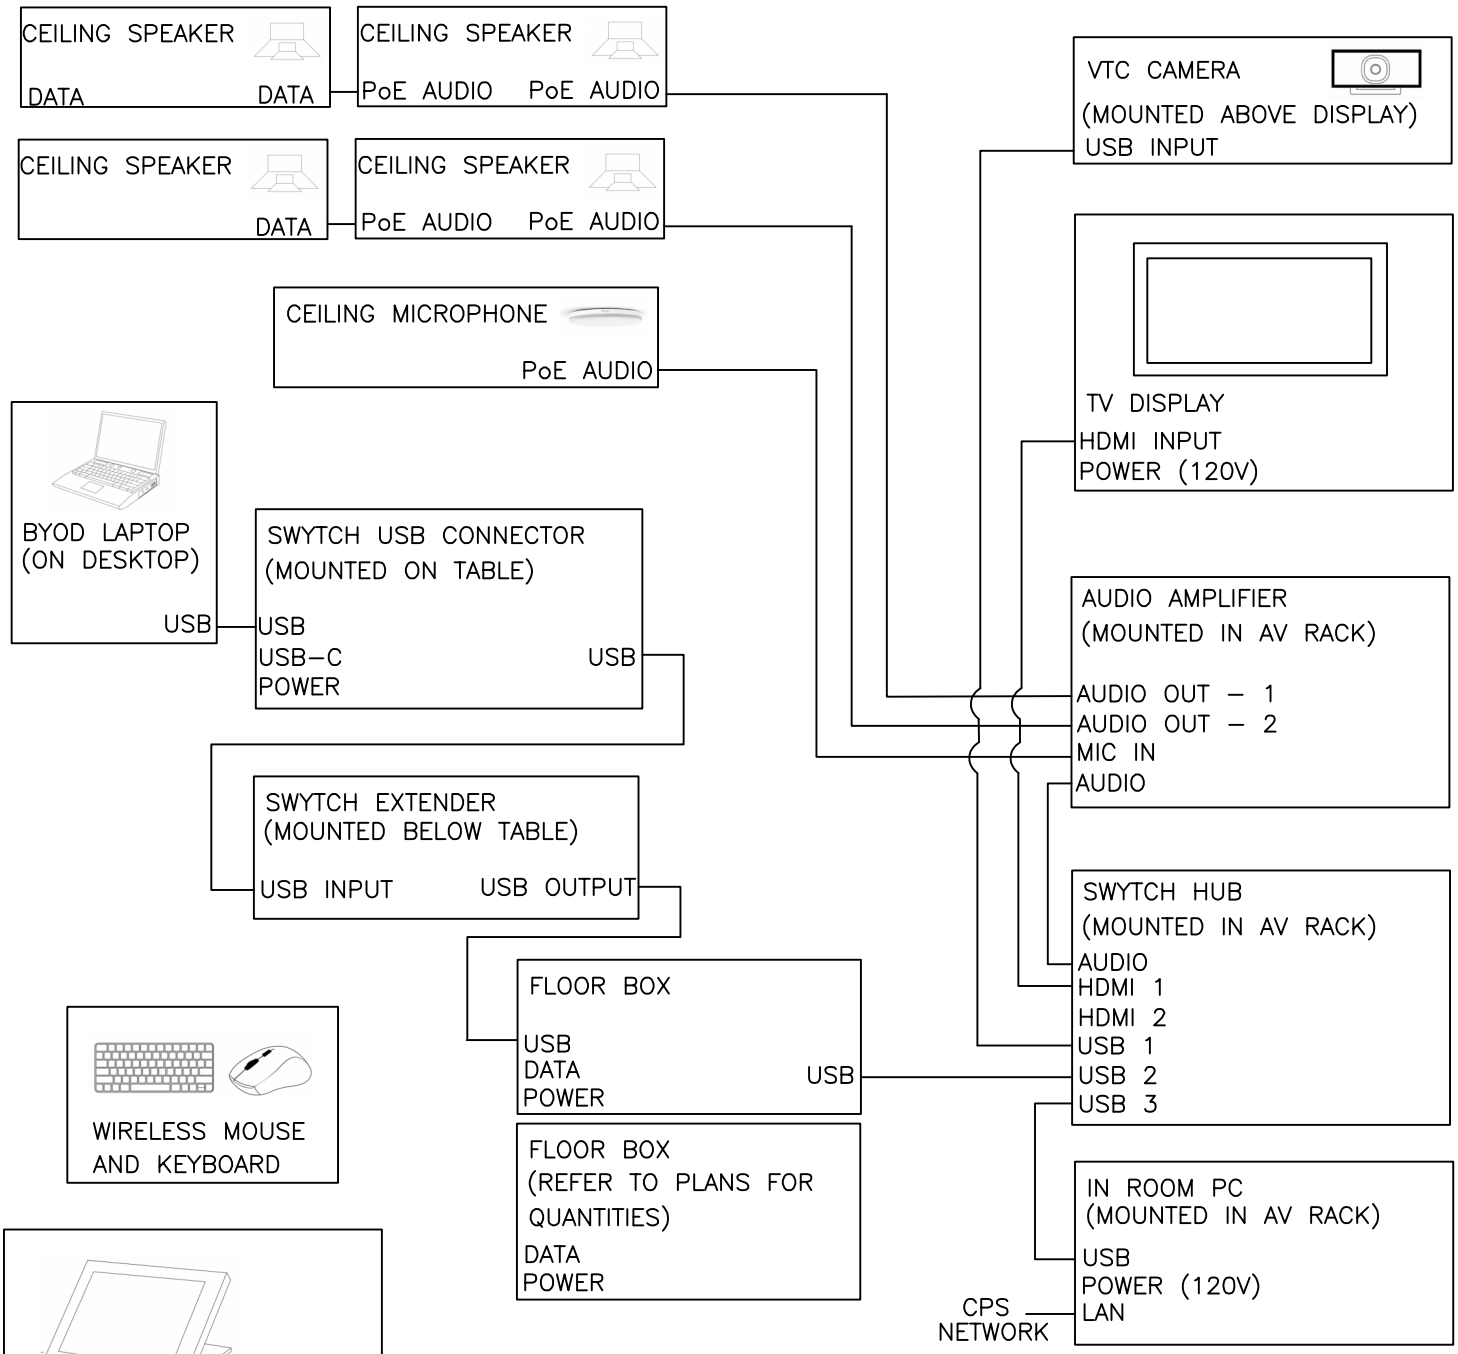

NOTES:

1. AUDIO VISUAL VENDOR TO PROVIDE SITE SPECIFIC DIAGRAMS.
2. COORDINATE CPS NETWORK CONNECTIONS WITH NETWORK OPERATIONS AS PART OF DESIGN.
3. ALL AUDIO VISUAL CABLING TO BE LABELED IN A CLEAR MANNER USING THE FOLLOWING DESIGNATION: "AVE" – "ROOM NUMBER OF AV RACK" – "ROOM NUMBER OF FAR END DEVICE"

CHICAGO PUBLIC SCHOOLS

CAPITAL IMPROVEMENT PROGRAM
INFORMATION TECHNOLOGY SERVICES

INFRASTRUCTURE STANDARDS

LARGE/MEDIUM CONFERENCE ROOM – TYPICAL AUDIO VISUAL DIAGRAM

NO.	DATE	REVISION	BY

DESIGNED CPS			SHEET NO.
DRAWN CPS			ED.341B
CHECKED CPS	PROJECT NUMBER	SCALE	DATE
APPROVED CPS		NONE	05/05/25