


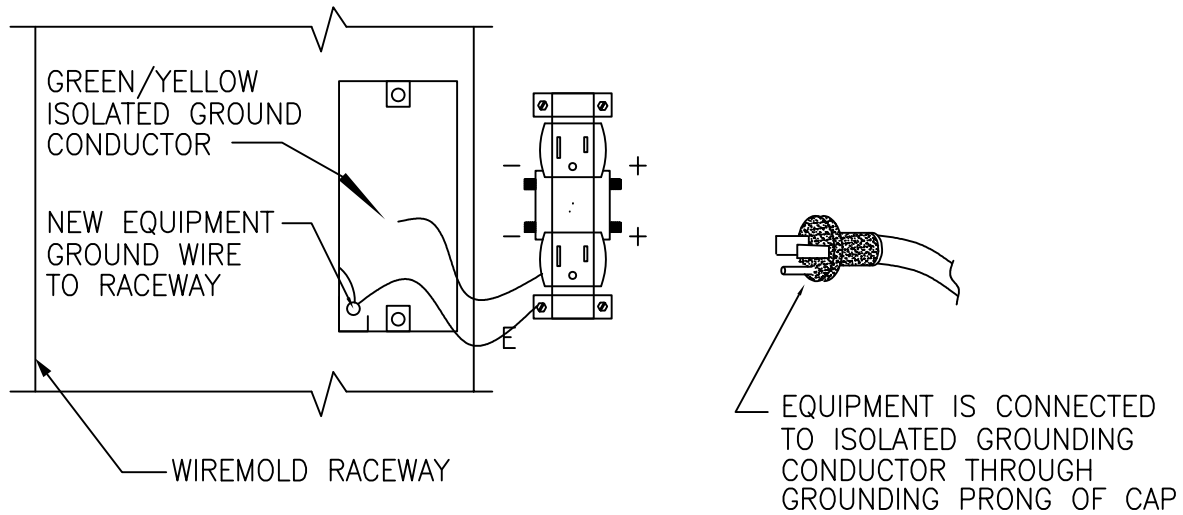

NOTES:

1. PER CPS SPECIFICATIONS, A #12 AWG STRANDED, GREEN, EQUIPMENT GROUND WIRE WILL BE CONNECTED TO THE WIREMOLD RACEWAY SECTION IN WHICH THE IG RECEPTACLE IS MOUNTED.

		CHICAGO PUBLIC SCHOOLS			SHEET NO.
		CAPITAL IMPROVEMENT PROGRAM			
		INFORMATION TECHNOLOGY SERVICES			
		INFRASTRUCTURE STANDARDS			
		ISO. GROUND RECEPTACLES			ED.910
		DIAGRAM			
		PROJECT NUMBER	SCALE NONE	DATE 06/01/24	
DESIGNED	CPS				
DRAWN	CPS				
CHECKED	CPS				
APPROVED	CPS				
NO.	DATE	REVISION	BY		