



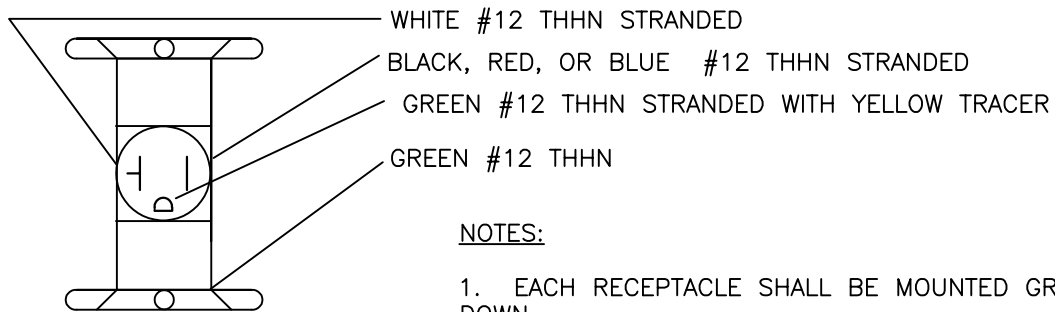

NOTES:

1. EACH RECEPTACLE SHALL BE MOUNTED GROUND DOWN.
2. WHEN USING A 1/2" RAISED INDUSTRIAL COVER, THE RECEPTACLE SHALL BE MOUNTED TO THE COVER VIA THE MOUNTING HOLES IN THE EARS OF THE RECEPTACLE AND THE CENTER SCREW
3. PER CPS SPECIFICATIONS, ALL WIRE WILL HAVE THHN INSULATION.
4. WIRE GAUGE /SIZE WILL BE DETERMINED BY THE CITY OF CHICAGO CODE.

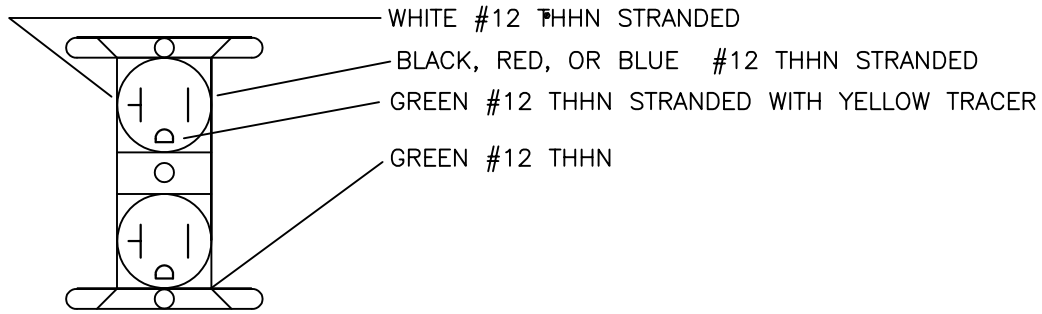

CHICAGO PUBLIC SCHOOLS
CAPITAL IMPROVEMENT PROGRAM
INFORMATION TECHNOLOGY SERVICES
INFRASTRUCTURE STANDARDS
TYPICAL 20A ISOLATED GROUND
RECEPTACLES

				DESIGNED	PROJECT NUMBER	SCALE NONE	DATE 06/01/24	SHEET NO. ED.911
				CPS				
				DRAWN				
				CPS				
				CHECKED				
				CPS				
				APPROVED				
				CPS				
NO.	DATE	REVISION	BY					