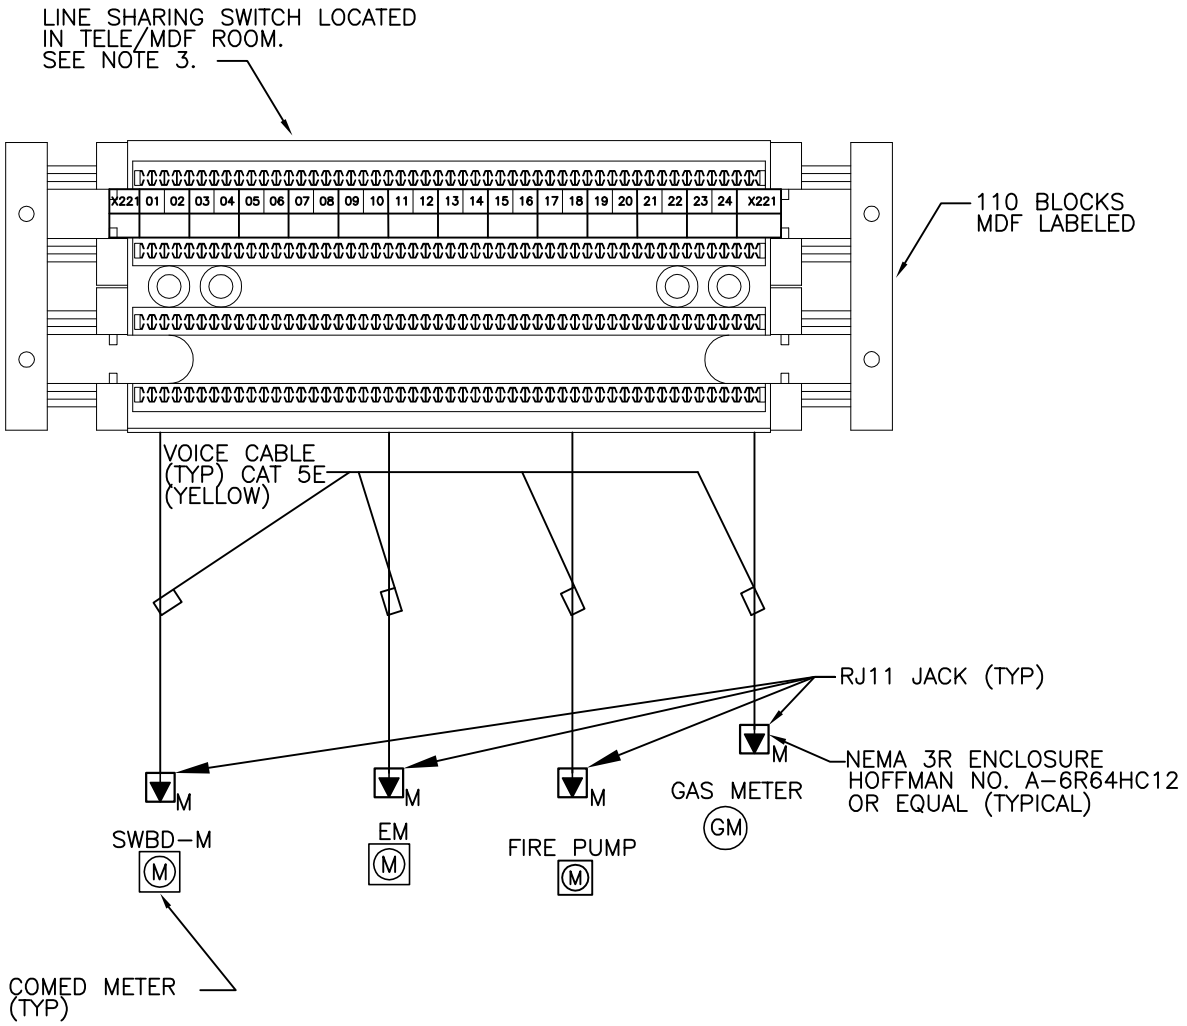

NOTES:

1. LEAVE 18" OF SLACK CABLE AT EACH OUTLET LOCATION.
2. ELECTRICAL METERS SHALL BE INSTALLED IN SWITCHBOARDS REFER TO ELECTRICAL RISER DIAGRAM.
3. COMED SHALL PROVIDE REQUIRED STANDARDS FOR LINE SHARING SWITCH.
4. A VOICE OUTLET IS REQUIRED FOR EACH UTILITY SERVICE METER. WIRE BACK TO MDF 110 BLOCK.

M

CHICAGO PUBLIC SCHOOLS
CAPITAL IMPROVEMENT PROGRAM
INFORMATION TECHNOLOGY SERVICES

INFRASTRUCTURE STANDARDS

AUTOMATIC METER READER
OUTLET SCHEMATIC DIAGRAM

NO.	DATE	REVISION	BY

DESIGNED CPS			SHEET NO.
DRAWN CPS			ED.807
CHECKED CPS	PROJECT NUMBER	SCALE NONE	DATE 08/28/08
APPROVED CPS			